



BLUESTONE PITCHER KERB AND PITCHER CHANNEL

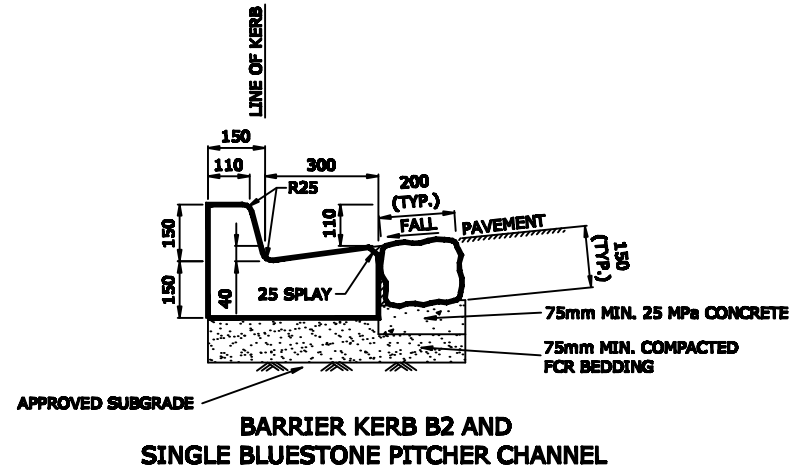

BARRIER KERB B2 AND SINGLE BLUESTONE PITCHER CHANNEL

NOTES:

1. PITCHER SIZE SHOWN IS AN AVERAGE SIZE ONLY.
2. ALL GROUTED JOINTS TO BE 30mm (MAX) WIDE TO FULL DEPTH OF PITCHER.
3. BLUESTONE JOINTS TO BE FILLED WITH A GROUT MIX OF: 16% CEMENT, 16% STONEDUST, 67% BLENDED WASHED SAND AND 1% LIME WITH BAYER SYNTHETIC COLOUR OXIDE ADDED AT A RATE OF 40 KG/M³ THOROUGHLY MIXED THROUGH THE GROUT. (CHARCOAL COLOURED GROUT)
4. ALL EXCESS GROUT TO BE REMOVED FROM THE SURFACE OF THE BLUESTONE.
5. WHEN SPECIFIED 100mm DIA. SUB-SOIL DRAINS ARE TO BE CONSTRUCTED BEHIND THE BLUESTONE KERBING AS SHOWN.
6. CONCRETE BACKFILL WILL BE REQUIRED BEHIND KERB.
7. CONCRETE COMPRESSIVE STRENGTH SHALL BE 25 MPa AT 28 DAYS.
8. ALL DIMENSIONS ARE IN MILLIMETRES.
9. CHANNEL GRADE AT 1 IN 10 UNLESS NOTIFIED OTHERWISE.
10. CONCRETE COLOUR FOR B2 KERB & CHANNEL:
 - THE COLOUR OF CONCRETE TO BE USED IS EITHER PLAIN OR CHARCOAL COLOURED DEPENDING ON THE COLOUR OF MATERIAL REQUIRED TO BE MATCHED.
 - FOR CHARCOAL COLOURED CONCRETE USE HANSON "EBONY" COLOUR OR 15kg "BLACK OXIDE" BAYER 318 PER CUBIC METRE CONCRETE OR APPROVED EQUIVALENT.
 - APPROVAL ON THE COLOUR MUST BE OBTAINED FROM COUNCIL'S SUPERINTENDENT PRIOR TO COMMENCEMENT OF ANY KERB & CHANNEL WORKS.
11. USE 20mm CLASS 2 FCR FOR SUB BASE MATERIAL COMPACTED TO 95% MOD TEST

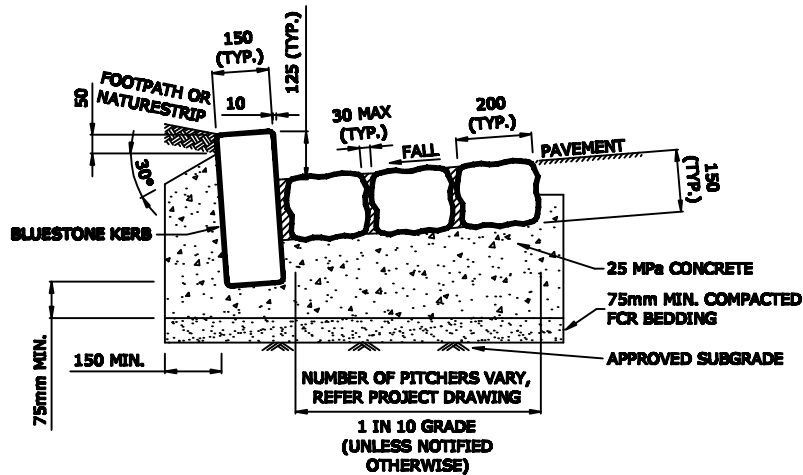

BLUESTONE (DRESSED) KERB AND PITCHER CHANNEL

NOTES:

E				
D	FINAL	NP	AN	30/07/10
C	FINAL	NP	AN	02/04/09
B	FINAL	NP	AN	26/06/08
A	FINAL	AA	LL	26/11/06

No. Description: Drawn: Checked: Date: REVISIONS:

DRAWN: NP
CHECKED: AN
AUTHORISED: AN

DATE PLOTTED: DATE PLOTTED

SCALE: 1:20



DRAWING TITLE:
BLUESTONE KERB & CHANNEL

DRG. No. SD 1102 REVISION: D